

## Capacity Rating of Thermostatic Expansion Valves

1	Purpose.....	1
2	Scope.....	1
3	Definitions.....	1
3.1	Capacity.....	1
3.2	Superheat.....	3
4	Nominal rating conditions for non zeotropic refrigerants.....	3
5	Nominal rating conditions for zeotropic blend refrigerant : Example R407C.....	5
6	Capacity units and the conversion to ARI standard.....	6

### 1 Purpose

The purpose of this statement is to provide common definitions of terminology and rating conditions for thermostatic expansion valves within the European refrigeration and air conditioning market.

### 2 Scope

This statement is valid for thermostatic expansion valves (hereinafter “TXV”). A TXV is a mechanical device which controls the refrigerant mass flow by sensing pressure and temperature. Other expansion devices such as automatic expansion valves, orifices, capillary tubes are excluded from this statement. This statement is valid for the evaporation temperature range of  $-50^{\circ}\text{C}$  to  $+25^{\circ}\text{C}$ .

### 3 Definitions

#### 3.1 Capacity

The capacity of a valve is defined as the cooling capacity ( $\dot{Q}_o$ ):

$$\dot{Q}_o = \dot{m} \times \Delta h = \dot{m} \times (h_o - h_c)$$

Where

$\dot{m}$  is the mass flow rate.

$h_o$  is the specific enthalpy of the saturated gas at the outlet of the evaporator.

$h_c$  is the specific enthalpy of the partly evaporated refrigerant at the inlet of the evaporator.

The enthalpy differential is seen to be dependent on  $t_c$ , (Bubble Point of condensation),  $\Delta t_{Eu}$  (Subcooling of liquid refrigerant) and  $t_o$ , (Dew Point of evaporation) (see Fig. 1).

# STATEMENT

Last update: Sep-2005

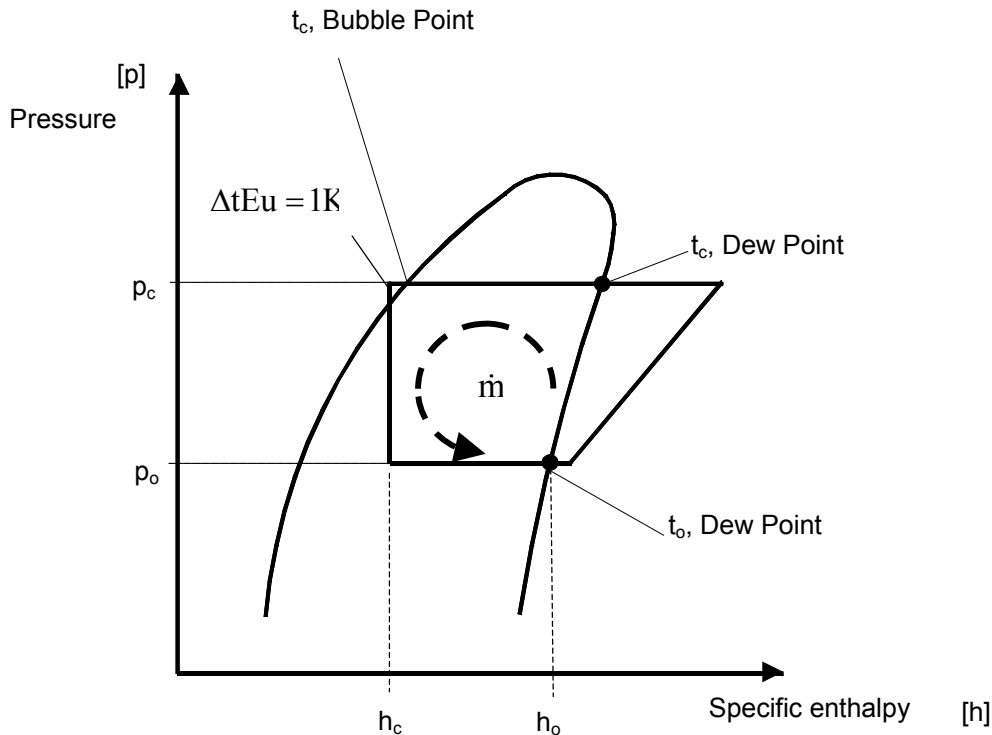


Fig. 1: Pressure – Enthalpy diagram

$p_c$ : Condensing pressure at Bubble Point  
 $p_o$ : Evaporating pressure at Dew Point

The mass flow through the valve depends on refrigerant type, opening degree of the valve and the pressure drop across the valve. Pressure drop in distributors and evaporator is assumed to be zero.

- Nominal capacity ( $\dot{Q}^n$ ) is defined as the capacity given by the valve manufacturer at nominal rating conditions (see Fig. 2).
- Maximum capacity ( $\dot{Q}^{\text{max.}}$ ) is defined as the highest capacity at nominal rating conditions.
- Reserve capacity ( $\dot{Q}^r$ ) is defined as difference between  $\dot{Q}^{\text{max.}}$  and  $\dot{Q}^n$ .

# STATEMENT

Last update: Sep-2005



## 3.2 Superheat

- Superheat (SH) is defined as the difference between the measured temperature and the saturated temperature of the refrigerant.
- Static Superheat (SS) relates only to the TXV and is defined as the superheat below which the valve remains closed and above which the valve starts to open.
- Opening superheat (OS) is the incremental superheat above SS required to achieve  $\dot{Q}_n$ .
- Working Superheat (WS) is the sum of SS and OS and can be measured in the field.
- Factory setting is the preadjusted SS value from valve manufacturer as delivered.

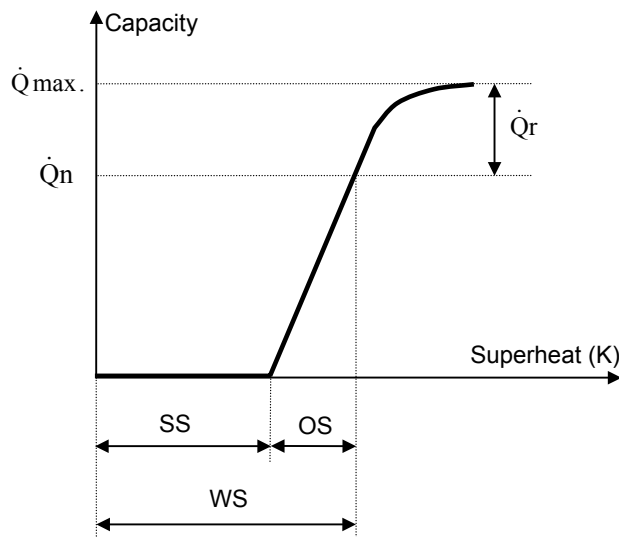


Fig. 2: Capacity – Superheat diagram

## 4 Nominal rating conditions for non zeotropic refrigerants


The nominal capacity of a TXV must be calculated the following nominal rating conditions:

Evaporating temperature	+4°C
Condensing temperature	+38°C
Subcooling	1 K
Rated differential pressure across TXV	Rated differential pressure is the difference in pressures at rated condensing temperature and at rated evaporating temperature.
Static Superheat	3 to 4 K
Opening Superheat	Max. 5K for rated capacity - see note below

**NOTE:** Up to the rated capacity there is a linear relationship between capacity and opening superheat. Higher opening superheat results in higher capacity and vice versa.

# STATEMENT

Last update: Sep-2005

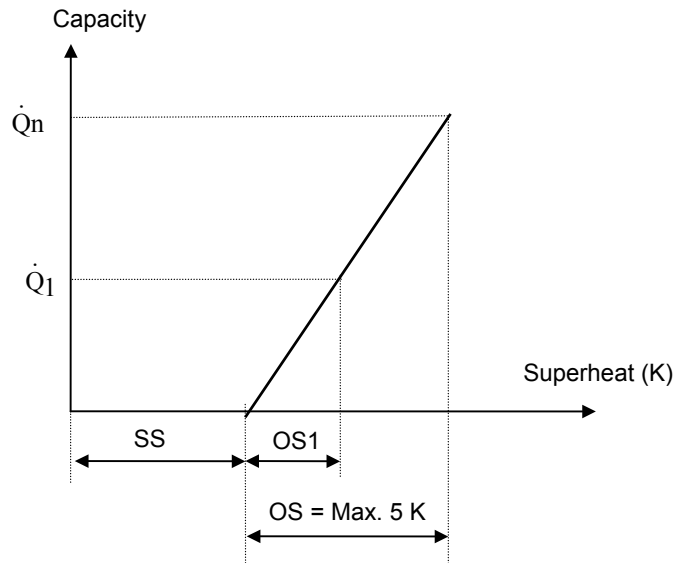

**Fig. 3:** Capacity – Superheat diagram

Rated differential pressure for some of common refrigerants

Refrigerant	Condensing pressure $p_c$ at $t_c = +38^\circ\text{C}$ bara	Evaporating pressure $p_o$ at $t_o = +4^\circ\text{C}$ bara	Rated differential pressure across TXV, bar
R134a	9.63	3.38	6.25
R22	14.60	5.66	8.94
R404A	17.47	6.85	10.62
R507	17.86	7.12	10.74
R410A	23.03	9.03	14.00

**NOTE 1:** Not all refrigerants are listed

**NOTE 2:** R404A is a zeotropic blend but due to the small glide it behaves like a non-zeotropic refrigerant for TXV rating purposes

In practice a cooling system will have pressure losses in the system – therefore the effective differential pressure across the TXV is always lower than the rated differential pressure and can be calculated as follows:

$$\Delta p_{\text{effective}} = p_c - (p_o + \Delta p_L + \Delta p_F + \Delta p_{SI} + \Delta p_{SO} + \Delta p_{LD} + \Delta p_E)$$

Where:

- $p_c$ : Condensing pressure at Bubble Point
- $p_o$ : Evaporating pressure at Dew Point
- $\Delta p_L$ : Pressure drop through entire liquid line
- $\Delta p_F$ : Pressure drop through liquid line filter drier
- $\Delta p_{SI}$ : Pressure drop through liquid line sight glass
- $\Delta p_{SO}$ : Pressure drop through liquid line solenoid valve
- $\Delta p_{LD}$ : Pressure drop through liquid distributor to evaporator
- $\Delta p_E$ : Pressure drop through evaporator

**NOTE:** For calculating the rating capacity of the TXV all pressure drops are assumed to be zero. However, when selecting a TXV for a specific application / installation, the pressure drops in the system must be taken into consideration.

# STATEMENT

Last update: Sep-2005



## 5 Nominal rating conditions for zeotropic blend refrigerant : Example R407C

As opposed to single substances (e.g. R22, R134a etc.), where the phase change takes place at a constant temperature / pressure. The evaporation and condensation of zeotropic blend R407C is in a “gliding” form (e.g. at a constant pressure the temperature varies within a certain range) through evaporators and condensers.

This has an impact on capacity of TXVs as well as other component such as compressor and must be taken into the consideration.

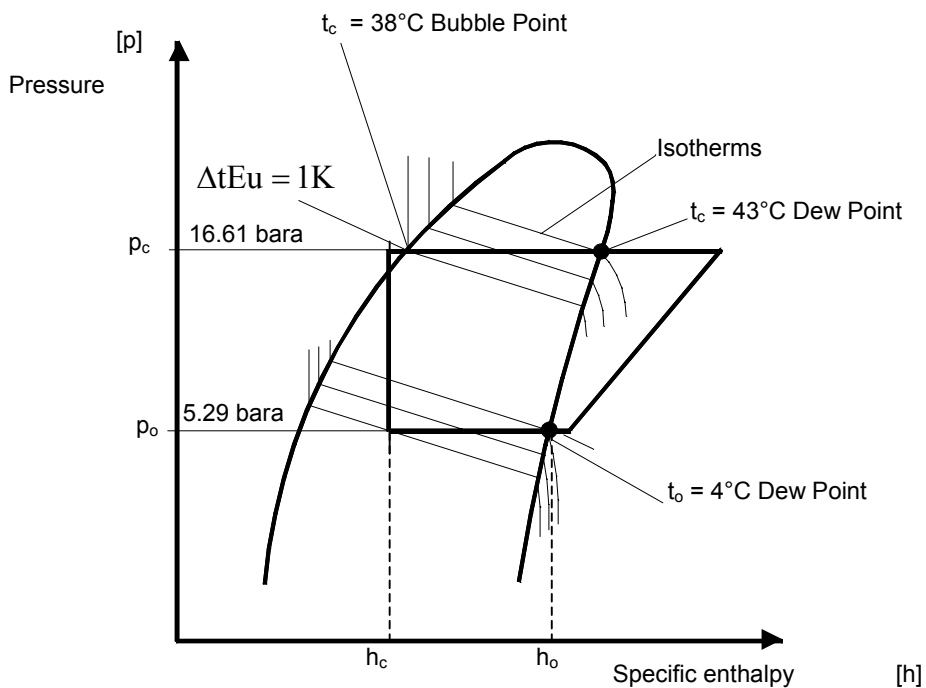


Fig. 4: Pressure – Enthalpy diagram

Evaporating temperature	+4°C Dew Point
Evaporating pressure	5.29 bara.
Condensing temperature	+38°C Bubble Point corresponding to +43°C Dew Point
Condensing pressure	16.61 bara. (the pressure drop across the condenser is neglected)
Subcooling	1 K
Rated differential pressure across TXV	11.32 bar differential
Static superheat (Factory setting)	3 to 4 K
Opening superheat	max. 5K

The correlation between Bubble Points and Dew Points for refrigerant R407C can be taken from appendix.

# STATEMENT

Last update: Sep-2005



## 6 Capacity units and the conversion to ARI standard

The TXV capacity defined in this statement can not be directly converted to ARI defined capacities due to the different rating conditions.

This statement defines the thermodynamic differential pressure corresponding to rated temperatures.

The ARI standard rates TXVs at given differential pressures, which are not thermodynamically correlated to the rated temperatures.

ARI rating conditions for TXVs				Thermodynamic differential pressure corresponding to liquid and evaporating temperature, bar (psi)
Refrigerant	Liquid temperature, °C (F)	Evaporating temperature, °C (F)	ARI Rated differential pressure across TXV, bar (psi)	
R134a	+37.8°C (+100F)	+4.4 °C (+40F)	4.14 (60 psi)	6.16 (89 psi)
R22			6.9 (100psi)	8.80 (128psi)
R404A				10.46 (152 psi)
R407C				11.17 (162 psi)
R507				10.56 (153 psi)
R410A			11.03 (160psi)	13.77 (200 psi)


Comparison of differential pressure rating, bar (psi)

Refrigerant	ASERCOM statement +38.0 / +4.0 °C	ARI Standard +37.8 / +4.4 °C
R134a	6.25 (91 psi)	4.14 (60 psi)
R22	8.94 (130 psi)	6.9 (100 psi)
R404A	10.62 (154 psi)	6.9 (100 psi)
R407C	11.32 (164 psi)	6.9 (100 psi)
R507	10.74 (156 psi)	6.9 (100 psi)
R410A	14.00 (203 psi)	11.03 (160 psi)

The metric kW capacities can be converted to ARI tonnage if the differences in rated differential pressures are taken into account.

# STATEMENT

Last update: Sep-2005



## 7 Appendix: Effect of Glide in a condenser without pressure drops

Saturated pressure		R407C Bubble temperature	Dew temperature	Differential
pc, bara	pc, barg	tc, °C	to, °C	K
9.0	8.0	15	21	6
9.2	8.2	16	22	6
9.5	8.5	17	23	6
9.8	8.8	18	24	6
10.1	9.1	19	25	6
10.4	9.4	20	26	6
10.6	9.6	21	27	6
10.9	9.9	22	28	6
11.3	10.3	23	28	5
11.6	10.6	24	29	5
11.9	10.9	25	30	5
12.2	11.2	26	31	5
12.5	11.5	27	32	5
12.9	11.9	28	33	5
13.2	12.2	29	34	5
13.6	12.6	30	35	5
13.9	12.9	31	36	5
14.3	13.3	32	37	5
14.7	13.7	33	38	5
15.0	14.0	34	39	5
15.4	14.4	35	40	5
15.8	14.8	36	41	5
16.2	15.2	37	42	5
16.6	15.6	38	43	5
17.0	16.0	39	44	5
17.4	16.4	40	45	5
17.9	16.9	41	46	5
18.3	17.3	42	47	5
18.8	17.8	43	48	5
19.2	18.2	44	49	5
19.7	18.7	45	50	5
20.1	19.1	46	51	5
20.6	19.6	47	52	5
21.1	20.1	48	53	5
21.6	20.6	49	53	4
22.1	21.1	50	54	4
22.6	21.6	51	55	4
23.1	22.1	52	56	4
23.7	22.7	53	57	4
24.2	23.2	54	58	4
24.8	23.8	55	59	4
25.3	24.3	56	60	4

**NOTE:** The temperature values are rounded.

# STATEMENT

Last update: Sep-2005



---

These recommendations are addressed to professionals, industrial, commercial and domestic refrigeration system manufacturers / installers. They have been drafted on the basis of what *ASERCOM* believes to be the state of scientific and technical knowledge at the time of drafting, however, *ASERCOM* and its member companies cannot accept any responsibility for and, in particular, cannot assume any reliability with respect to any measures - acts or omissions - taken on the basis of these recommendations.

---